



## OPTIMIZATION OF LOAD GRAPHS OF ENTERPRISES WITH SOLAR PHOTOVOLTAIC POWER PLANTS

Abdullaev Elnur Akhmatovich

Associate Professor, Jizzakh Polytechnic Institute,  
Department of “Energy and Electrical Technology”

### Abstract

At present, one of the most important issues at the level of various manufacturing enterprises is the development of ways for building and efficiently using of renewable energy sources, especially solar energy. In this regard, this article proposes a mathematical model of the problem of determining the optimal daily mode of operation of a photovoltaic system in an enterprise with a private photovoltaic system connected to the electrical system.

**Keywords:** Optimization, renewable energy source, power station, load schedule, mathematical model, photovoltaic station.

### INTRODUCTION

In the world today, consumers with power plants operating on renewable energy sources are using the particle swarm optimization method to optimally control the power, find the best configurations and determine the dimensions of the components. [1-3]. Many scientific publications have considered the issues of determining the optimal size of power plants working on renewable energy sources, and minimization of production and maintenance costs is considered as an objective function. However, optimal scheduling of consumer load schedules has not been considered in these developments [4-6].

The advantages of renewable energy sources, unlike oil and gas reserves, are that they are environmentally friendly and unlimited. Therefore, sooner or later, the energy supply system of all countries is moving to the widespread use of renewable energy sources. [7-8]. Therefore, a number of works are being carried out in the Republic of Uzbekistan on the construction and use of solar and wind power systems from devices operating at the expense of renewable energy sources. In order to effectively build and use such devices, it is necessary to determine their optimal parameters in advance based on the use of suitable mathematical models and algorithms [9-15].





## OPTIMIZATION METHOD

In addition to the solar panels that generate electricity, the solar photoelectric power station installed at the enterprise includes additional equipment, such as hybrid inverters, a device that controls the power generated in the photoelectric station and converts direct current into alternating current, and a monitor system that monitors the parameters of the station's operating mode. Among these equipments, it is possible to include the accumulator battery, which is used for rational use of the generated electricity.

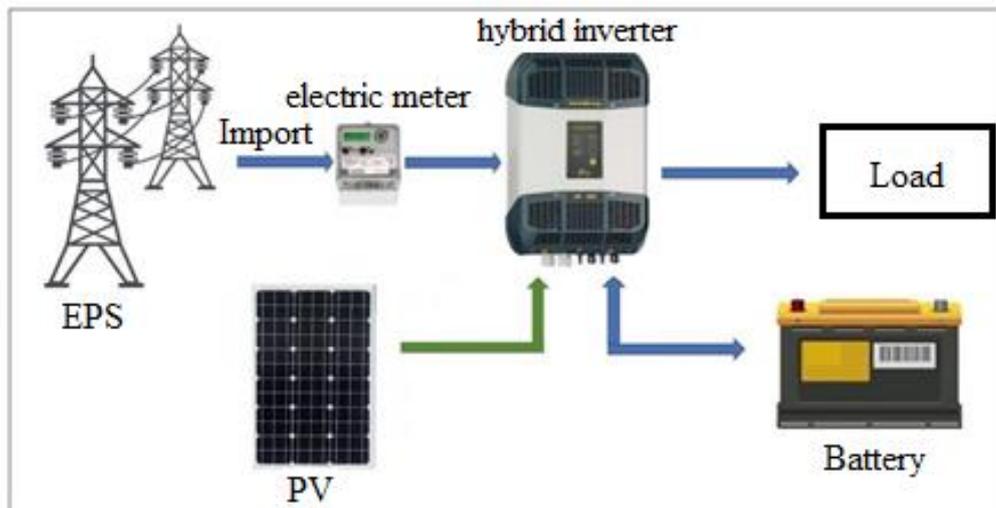


Figure 1. The principle diagram of the power supply of a consumer with a solar photovoltaic plant connected to the electric power system

We consider the issue of optimal coverage of the load schedule of an enterprise with a solar photovoltaic power station with an accumulator battery installed with the help of this station and the electric power system. Figure 1 shows the principle diagram of the power supply of a consumer with a solar photovoltaic plant connected to the electric power system.

In solving this problem, the electric capacity of the battery  $W$ , the load graph of the consumer for the planned day  $P_L(t)$ , the definition of the purchase of electricity from the electric power system  $C_t$ , the power graph of the solar photovoltaic power plant  $P_{PV}(t)$ , the minimum and maximum limit capacities of the battery battery charging (the discharge capacity is taken with a negative sign) is known data. The unknowns that can be determined as a result of solving the problem are the optimal active power graph  $P_{G.PV}(t)$  provided by the solar photovoltaic power plant to the consumer, the optimal active power graph received from the electric power system (optimal load



graph of the consumer in relation to the electric power system)  $P_{PS}(t)$  and the optimal charging of the accumulator battery/ the discharge power graph is  $P_{B.PV}(t)$ .

To solve this problem, the following mathematical model of the optimization problem is proposed. According to it, the objective function to be minimized is the function of the total costs associated with the electricity received from the solar photovoltaic power plant and the electric power system during the day [16]:

$$Z = \sum_{t=1}^{24} [C_t P_{PS}^{(t)} + \beta P_{G.PV}^{(t)}] \rightarrow \min$$

here,  $C_t$  is the price (tariff) of electricity received from the electric power system at  $t$ -th hour of the day;  $P_{PS}^{(t)}$  – active power received from the electric power system at  $t$ -th hour of the day;  $P_{G.PV}^{(t)}$  is the active power provided by the solar photovoltaic power plant at the  $t$ -hour of the day;  $\beta$  - the coefficient that includes the costs of production, installation, operation and maintenance of solar modules and equipment serving it is calculated.

Boundary conditions:

active power balance in enterprise for each hour of the day:

$$P_{PS}^{(t)} + P_{G.PV}^{(t)} = P_L^{(t)}, \quad t = 1, 2, \dots, 24$$

the condition that for each hour of the day the power of photovoltaic plant is equal to the sum of power consumed to charge the battery and power output from the inverter:

$$P_{PV}^{(t)} - P_{B.PV}^{(t)} = P_{G.PV}^{(t)}, \quad t = 1, 2, \dots, 24$$

the limit condition for the maximum possible charge/discharge capacity of the battery (negative sign means the discharge power):

$$-P_{B.PV.max} \leq P_{B.PV} \leq P_{B.PV.max}, \quad t = 1, 2, \dots, 24$$

inequality on minimum and maximum power that can be produced every hour of the day (determined by the power of inverter):

$$0 \leq P_{G.PV}^{(t)} \leq P_{G.PV.max}^{(t)}, \quad t = 1, 2, \dots, 24$$

inequality on energy capacity of the battery:

$$W_{bal.PV} + \sum_{k=1}^{t-1} [P_{PV}^{(k)} - P_{G.PV}^{(k)}] * \Delta t^{(k)} \leq W_{PV}, \quad t = 2, 3, \dots, 24$$

where:  $P_{PV}^{(t)}$  is the active power of the solar photovoltaic power station at the  $t$ -th hour of the day;  $P_L^{(t)}$  – the total active power load of the consumer at the  $t$ -th hour of the day;  $P_{B.PV.max}$  is the maximum possible charge or discharge capacity of the battery;



$P_{G.PV.max}^{(t)}$  is the maximum power that can be produced for consumption by the solar photovoltaic power plant at the t-th hour of the day;  $W_{PV}$  is the electrical capacity of the battery installed in the solar photoelectric plant;  $W_{bal.PV}$  is the remaining electric charge of the battery installed in the solar photovoltaic power station from the previous day

## REFERENCES

1. Hanieh Borhanazad, Saad Mekhilef, Velappa Gounder Ganapathy, Mostafa Modiri-Delshad, Ali Mirtaheri. Optimization of micro-grid system using MOPSO. *Renewable Energy* 71 (2014). – pp. 295-306.
2. Motaz Amer, A. Namaane and N. K. M'Sirdi. Optimization of Hybrid Renewable Energy Systems (HRES) Using PSO for Cost Reduction. *Energy Procedia* 42 ( 2013). – pp. 318 – 327.
3. Mohamed A. Mohamed, Ali M. Eltamaly, Abdulrahman I. Alolah. PSO-Based Smart Grid Application for Sizing and Optimization of Hybrid Renewable Energy Systems. *PLOS ONE*. August 11, 2016. – pp. 1-22.
4. A. Kaabeche, M. Belhamel and R. Ibtouen. Optimal sizing method for stand-alone hybrid PV/wind power generation system. *Revue des Energies Renouvelables SMEE'10 Bou Ismail Tipaza* (2010). – pp. 205 – 213.
5. Hadi Nabipour Afrouzi, Ateeb Hassan, Yuhani Pamodha Wimalaratna, Jubaer Ahmed, Kamyar Mehranzamir, San Chuin Liew, Zulkurnain Abdul Malek. Sizing and economic analysis of stand-alone hybrid photovoltaic-wind system for rural electrification: A case study Lundu, Sarawak. *Cleaner Engineering and Technology* 4 (2021), 100191.
6. Hongxing Yang, Wei Zhou, Lin Lu, Zhaohong Fang. Optimal sizing method for stand-alone hybrid solar–wind system with LPSP technology by using genetic algorithm. *Solar Energy* 82 (2008). – pp. 354–367.
7. Abdullaev E. Solar Energy Resources and Their Rate of Development. *International Journal of Academic Engineering Research (IJAER)*. Vol. 5 Issue 4, April - 2021, Pages: 62-64.
8. Abdullaev E. Perspectives on the Application of Alternative Energy Sources. *International Journal of Engineering and Information Systems (IJEAIS)*. Vol. 5 Issue 4, April - 2021, Pages: 263-265.
9. Gayibov, T.Sh., Reymov, K.M., (2017). Optimal Planning of Short-Term Modes of Power Systems with Control of Loads of Electric Consumers and Taking into Account of Network Factor. *European Science Review*. 3(9-10), 86-91.





10. T.Sh. Gayibov, B.A. Uzakov, E.A. Abdullaev. (2020) Optimization of loading schedules of consumers with own stations on the basis of renewable energy sources. *Journal of critical reviews*. 7(15) 1738-1742.
11. Jordan Radosavljević, Nebojša Arsić, Miloš Milovanović, and Aphrodite Ktena. (2020). Optimal Placement and Sizing of Renewable Distributed Generation Using Hybrid Metaheuristic Algorithm. *Journal of modern power systems and clean energy*. 8(3), 499-510.
12. Tulkin Gayibov, Bekzod Pulatov, Sherxon Latipov, Gulnaz Turmanova: Power System Optimization in Terms of Uncertainty of Initial Information. *E3S Web of Conference* 139, 01031 (2019). RSES 2019. <https://doi.org/10.1051/e3sconf/201913901031>.
13. T Gayibov, Sh Latipov, D Abdurashidov, B Pulatov, A Davirov: Algorithm for power systems mode optimization taking into account the frequency change in terms of probabilistic nature of initial information. *IOP Conf. Series: Materials Science and Engineering*, 883, 012185 (2020). doi:10.1088/1757-899X/883/1/012185.
14. Tulkin Gayibov. Algorithm for optimization of power system short-term mode in conditions of partial uncertainty of initial information taking into account the frequency change. *E3S Web of Conference* 216, 01100 (2020). RSES 2020. <https://doi.org/10.1051/e3sconf/202021601100>.
15. Valdma M, Keel M, Liik O and Tammoja H.: Method of Minimax optimization of Power System Operation. In: Bologna Italy Proceedings of IEEE Bologna Power Tech. pp. 23-26 (2003).
16. Tulkin Gayibov., Elnur Abdullaev. Optimization of daily operation mode of photovoltaic systems of enterprises. *E3S Web of Conferences* 264, 04063 (2021) CONMECHYDRO – 2021. – pp. 1-8.

